


**NOTES**

- QUADRAPLEX SOFTENER, METER INITIATED, DEMAND RECALL SYSTEM, UNITS BROUGHT ON LINE BASED ON FLOW-RATE.
- SOFTENER EQUIPPED WITH 1.25" VALVE WITH MAIN CONTROLLER.
- MAXIMUM RECOMMENDED SYSTEM PRESSURE IS 100 PSI (690 kPa) AND MINIMUM INLET PRESSURE IS 40 PSI.
- MAXIMUM RECOMMENDED SYSTEM TEMPERATURE IS 100 °F (38 °C).
- REQUIRES 120 VOLT, 1 PHASE, 60 Hz ELECTRICAL POWER.
- ALL EXTERNAL PIPING, FITTINGS, AND VALVES SHOWN BY BROKEN LINES ARE SUPPLIED BY OTHERS.
- MINERAL TANKS AND MEDIA ARE NSF APPROVED.
- DUE TO SLIGHT EXPANSION AND CONTRACTION OF MINERAL TANK, PIPING MUST BE DESIGNED TO ALLOW SOME MOVEMENT. AS WELL AS BE PROTECTED FROM VACUUM. FLEX CONNECTORS AND A VACUUM BREAKER MAY BE REQUIRED. FAILURE TO INSTALL EITHER OF THEM OR IMPROPERLY INSTALL THEM MAY VOID THE WARRANTY.
- SYSTEM MUST BE INSTALLED TO COMPLY WITH ALL FEDERAL, STATE, PROVINCIAL, AND LOCAL CODES.
- FLOOR DRAINS MUST BE SIZED TO CARRY THE MAX. LISTED FLOW TO DRAIN.
- REFER TO THE INSTALLATION AND OPERATION MANUAL FOR FURTHER DETAILS.
- USE PROPER UNION OR FLANGE FOR THE PIPE CONNECTION TO VALVE FOR EASY MAINTENANCE.

**FLOW RATE PER UNIT**

Model (Quadraplex)	Capacity		Resin		Salt Usage		Critical	95 - 1.25"			Dimensions		Drain	Installation			Shipping	Operating
	15 lbs/ft <sup>3</sup>	10 lbs/ft <sup>3</sup>	ft <sup>3</sup>	m <sup>3</sup>	15 lbs/ft <sup>3</sup>	10 lbs/ft <sup>3</sup>	Flow	@ 15 PSI	@ 25 PSI	To Drain	Mineral Tank	Brine Tank	Pipe Size	Height	Depth	width	Weight	Weight
					kg	kg	USGPM	USGPM	USGPM	USGPM	in	in	in	in	in	in	in	lbs
<b>95MTS</b>	90000	3	45	30	15	25	25	35	5	14 x 65	24 x 37	1"	77	30	188	1,180	5,980	
<b>90-1.25"</b>	81000	0.08	20.45	13.64	0.95	1.58	2.21	0.32	356 x 1651	610 x 940	25	1,956	762	4,775	535	2,713		
95MTS	120000	4	60	40	20	27	38	7	16 x 65	24 x 37	1"	77	30	196	1,540	6,740		
<b>120-1.25"</b>	108000	0.11	27.27	18.18	1.26	1.70	2.40	0.44	403 x 1651	610 x 940	25	1,956	762	4,978	699	3,058		
<b>95MTS</b>	150000	5	75	50	25	32	43	8	18 x 65	24 x 37	1"	77	30	204	1,912	7,512		
<b>150-1.25"</b>	135000	0.14	34.09	22.73	1.58	2.02	2.71	0.51	475 x 1651	610 x 940	25	1,956	762	5,182	868	3,408		
95MTS	180000	6	90	60	30	31	42	11	21 x 62	29 x 50	1"	80	35	236	2,260	10,660		
<b>180-1.25"</b>	162000	0.17	40.91	27.27	1.89	1.96	2.65	0.69	533 x 1575	740 x 1275	25	2,032	889	5,994	1,025	4,837		
<b>95MTS</b>	210000	7	105	70	31	31	42	11	21 x 62	29 x 50	1"	80	35	236	2,472	10,872		
<b>210-1.25"</b>	189000	0.20	47.73	31.82	1.96	1.96	2.65	0.69	533 x 1575	740 x 1275	25	2,032	889	5,994	1,122	4,933		
95MTS	240000	8	120	80	32	32	44	17	24 x 72	29 x 50	1"	88	35	248	2,764	12,364		
<b>240-1.25"</b>	216000	0.23	54.55	36.36	2.02	2.02	2.78	1.07	610 x 1829	740 x 1275	25	2,235	889	6,299	1,254	5,610		
<b>95MTS</b>	270000	9	135	90	32	32	44	17	24 x 72	33 x 53	1"	88	39	264	3,024	14,624		
<b>270-1.25"</b>	243000	0.25	61.36	40.91	2.02	2.02	2.78	1.07	610 x 1829	840 x 1335	25	2,235	991	6,706	1,372	6,635		
95MTS	300000	10	150	100	32	32	43	17	24 x 72	33 x 53	1"	88	39	264	3,236	14,836		
<b>300-1.25"</b>	270000	0.28	68.18	45.45	2.02	2.02	2.71	1.07	610 x 1829	840 x 1335	25	2,235	991	6,706	1,468	6,731		
<b>95MTS</b>	330000	11	165	110	31	31	42	17	24 x 72	33 x 53	1"	88	39	264	3,448	15,048		
<b>330-1.25"</b>	297000	0.31	75.00	50.00	1.96	1.96	2.65	1.07	610 x 1829	840 x 1335	25	2,235	991	6,706	1,564	6,828		

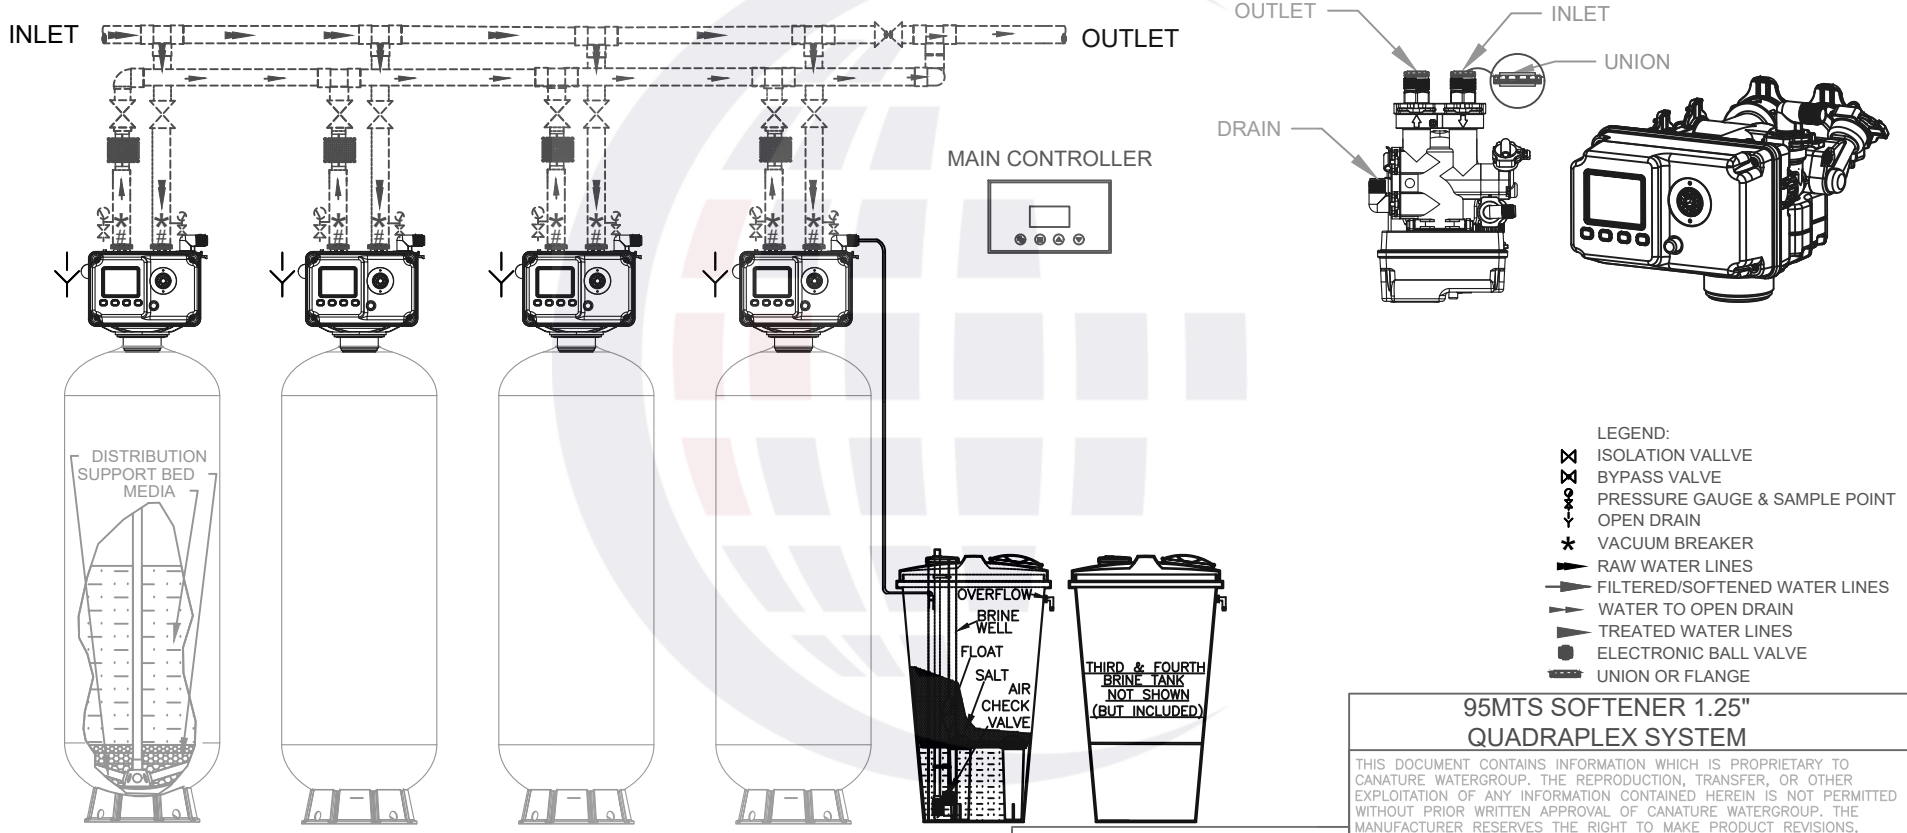

RAW WATER REGENERATION PIPING SHOWN



**95MTS SOFTENER 1.25"  
QUADRAPLEX SYSTEM**

THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO CANATURE WATERGROUP. THE REPRODUCTION, TRANSFER, OR OTHER EXPLOITATION OF ANY INFORMATION CONTAINED HEREIN IS NOT PERMITTED WITHOUT PRIOR WRITTEN APPROVAL OF CANATURE WATERGROUP. THE MANUFACTURER RESERVES THE RIGHT TO MAKE PRODUCT REVISIONS, WHICH MAY DEVIATE FROM THE SPECIFICATIONS AND DESCRIPTIONS STATED HEREIN WITHOUT OBLIGATION TO CHANGE PREVIOUSLY MANUFACTURED PRODUCTS OR TO NOTE THE CHANGE.

Project _____	Date <b>10-26-2017</b>	Rev <b>0</b>
	Dwg # <b>95MTS1.25Q</b>	